

Ultralox 40®

HOCl, active form of chlorine as a biocide

Potable and process water

Listed in the "List of Approved Products and Processes for use in Public Water Supply" published by the DWI Approved & Considered Products – Drinking Water Inspectorate (dwi.gov.uk)

Used widely in the NHS

SUITABLE FOR

Hot / cold systems

System purges

Hospitals

Hotels

Care homes

Schools

Small offices

Legionella control

Domestic systems

Drinking water

Breweries

Dairies

Food processing

CIP systems

Leisure centres

Poultry houses

And more ...

Ultralox40®

Approved hypochlorous acid, the active form of chlorine that works as a biocide



Low concentration, highly effective colourless biocide

Ultralox40® is an extremely efficacious fast-acting stable biocide (hypochlorous acid or HOCl). HOCl is manufactured naturally by white blood cells (neutrophils) as part of the body's defence against pathogens. HSG 274 cites "hypochlorous acid (HOCl) the form of chlorine that is most effective as a biocide". It breaks down biofilm and is highly effective against pathogens and bacteria. Particularly for systems with low and high pressure, high bacteria counts, embedded or systematic biofilm challenges, require repeated flushing and one-off disinfections and therefore have requirements for secondary disinfection.

Small and medium applications

Delivered in 25L, 200L or 1,000L package sizes. Can be dosed into incoming mains or a break tank, via fixed or mobile delivery and control systems that can be purchased or hired. The standard mobile or free-standing skid mounted systems can be retrofitted and are suitable for systems up to 40m³ /day. 200L systems are better suited for 50-60m³ /day requirements.

Constituents are BS EN approved (BS EN 900:2007 and BS EN 974:2003)

Appearance: colourless




Sg (at 20 °C): 1

Intended dose rate: 0.25 -1.0 ppm (for continuous dosing)

Drinking Water Inspectorate Approval (DWI 56/4/1530) under Regulation 31 of the Water Supply (Water Quality) Regulations 2016 (as amended).




Shock-dosed for 24 hours before maintenance 0.5ppm-1ppm in a food and beverage manufacturing site with stubborn bacteria counts

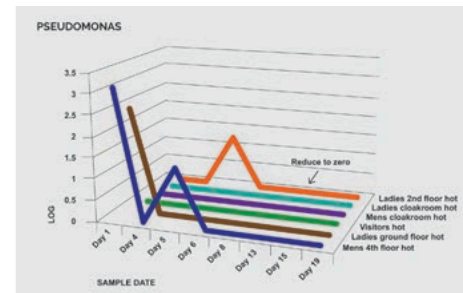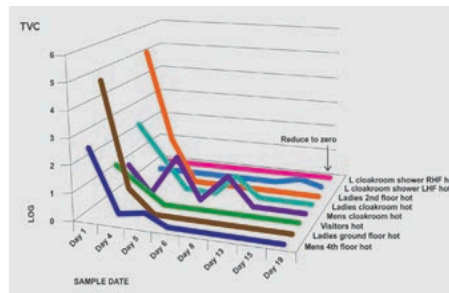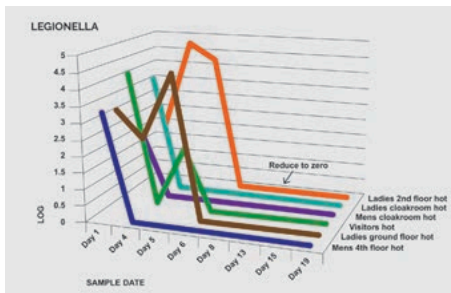

Disinfection comparison

Feature / Application	Ultralox 40	Super Heating and Flushing	Traditional Chlorination System	Chlorine Dioxide	Copper-Silver Ionisation System	Ultraviolet
Used on domestic cold-water systems	✓	✗	✓	✓	✓	✓
Used on domestic hot-water systems	✓	✓	✓	✓	✓	✓
Low hazard	✓	✗	✗	✗	✓	✓
Compatible with equipment and systems	✓	✓	✗	✓	Stains white porcelain	✓
Breaks down biofilm (at nominal operating conditions)	✓	✗	✗	✓	Ppm dependent	✗
Inhibits biofilm (at nominal operating conditions)	✓	✗	✓	✓	Ppm dependent	✗
Residual effectiveness against Legionella	✓	✗	✓	✓	✓	✗
Simple to monitor	✓	✓	✓	✓	✗	✓
Simple dosing equipment	✓	N/A	✓	Sometimes	✗	✓
Single package dosing	✓	N/A	✓	Sometimes	N/A	N/A

Skid system control and dosing

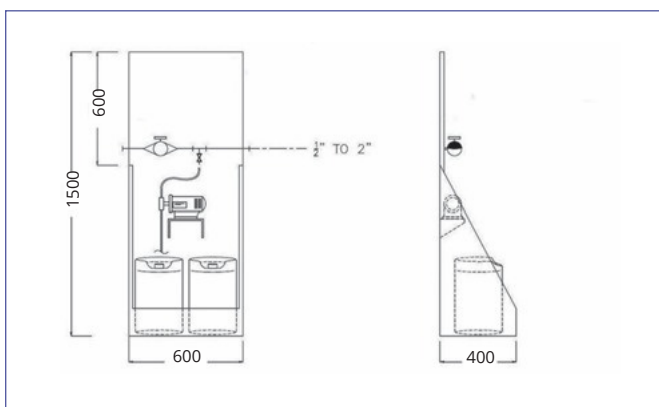

The kit comprises 2 x 25L or 1 x 200L options including;

- Chlorine Analyser / Controller
- Backboard and Ancillary systems
- 2 x 25L drum bund - Flow meter
- Dosing pump(s)
- Fused power supply
- Injection tubing and foot valve



01454 299 310



info@wcs-group.co.uk



wcs-group.co.uk/contact



MARLOWE Environmental Services



01454 299 310



info@wcs-group.co.uk



[wcs-group.co.uk/contact](https://www.wcs-group.co.uk/contact)